





CRC3

BAYCURB027B


Inner curb of Double Curb System

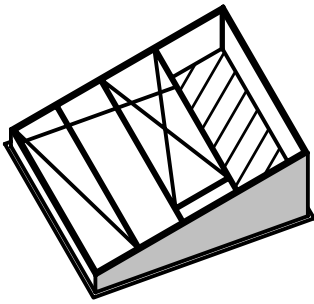


OPTION A

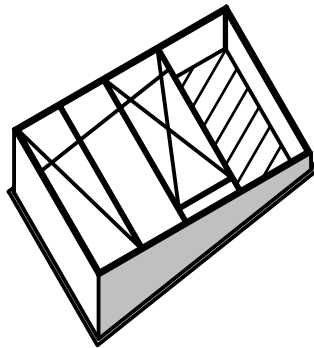



OPTION B

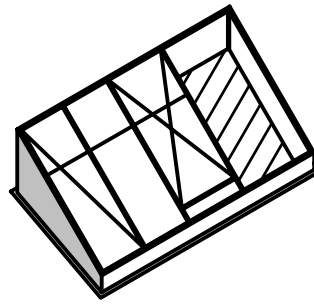

OPTION C

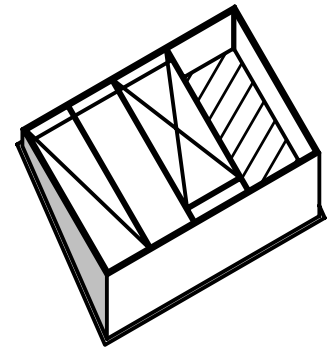


OPTION D

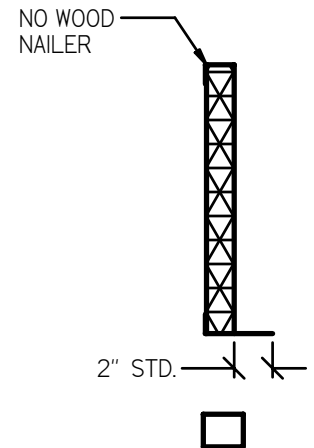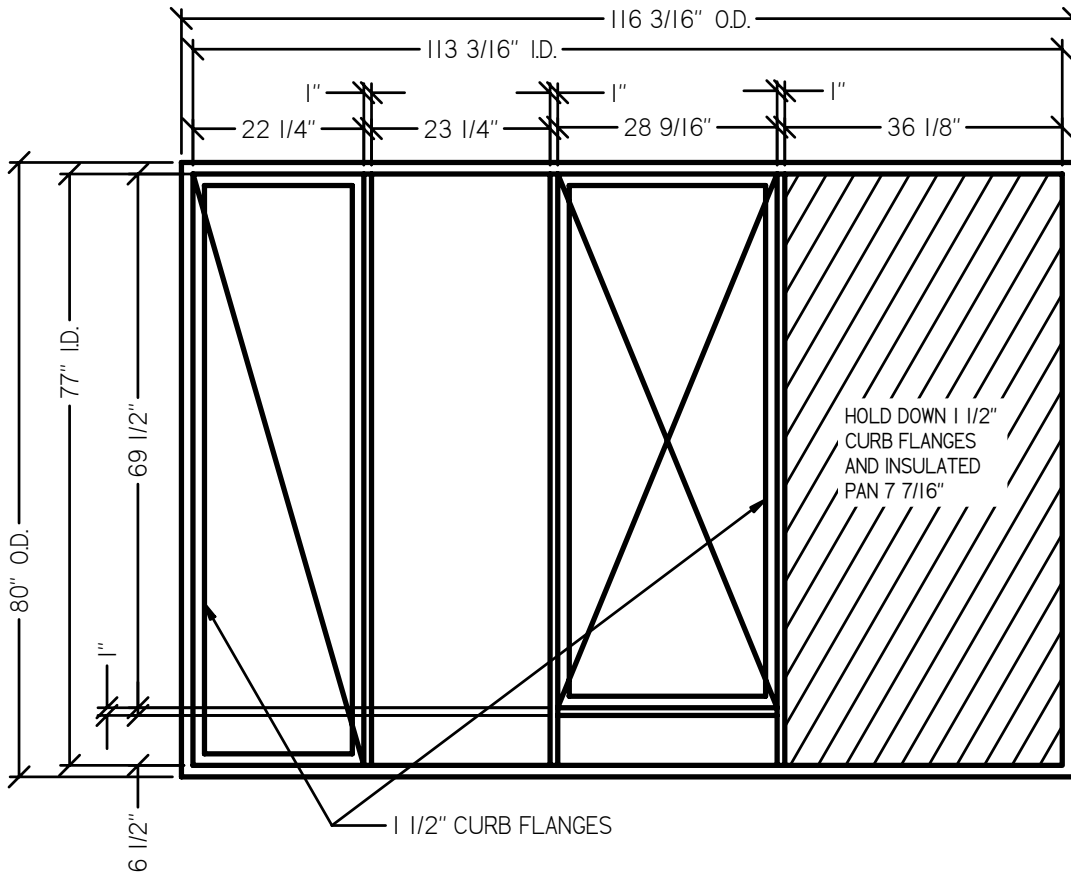


Slope: _____	Customer: _____
Min HT: _____	Job name: _____
Front Flange: _____	Qty: _____
Rear Flange: _____	Tag: _____
Side Flanges: _____	

DOUBLE CURB DETAILS

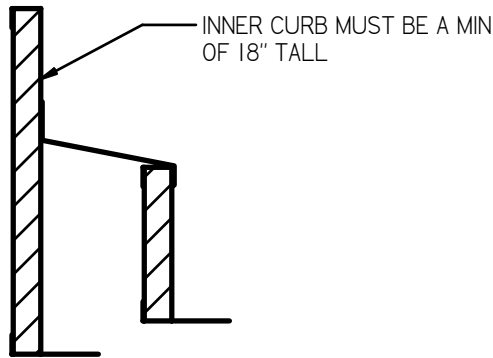


REQUIRED INSIDE DIMENSIONS FOR STRUCTURAL STEEL FRAMING FOR INNER CURB, BY BUILDING MANUFACTURER

SMALL SIDE BLOCKING WATER

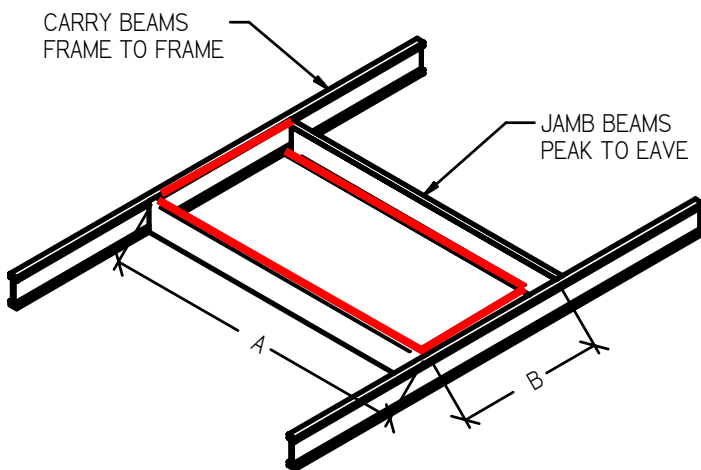

$$A = 113 \frac{3}{16}'' \quad B = 77''$$

WIDE SIDE BLOCKING WATER

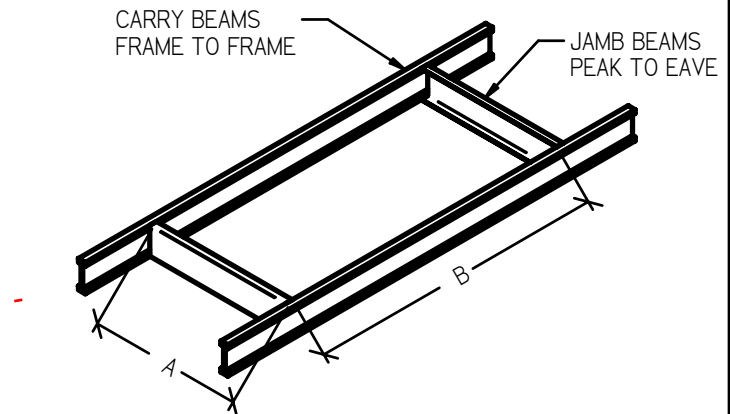



$$A = 77'' \quad B = 113 \frac{3}{16}''$$

NOTES:

1. MAIN BEAM TRANSFERS THE UNIT LOAD TO THE MAIN FRAMES AND RUNS PARALLEL TO PURLINS / BAR JOIST.
2. JAMB BEAMS SUPPORT THE SIDES OF THE INNER CURB, PURLINS SPLICE INTO THE JAMB BEAMS, AND RUNS PERPENDICULAR TO THE PURLINS.
3. INNER STRUCTURAL CURB SHOULD BE STITCH WELDED TO THE STRUCTURAL FRAMING OR SECURELY BOLTED TO THE FLANGES OF THE I-BEAMS AND JAMB BEAMS.
4. ALL STRUCTURAL STEEL REQUIREMENTS, BEAM SELECTIONS, SIZING, AND ATTACHMENTS ARE THE RESPONSIBILITY OF THE BUILDING SUPPLIER, STRUCTURAL ENGINEER, OR GENERAL CONTRACTOR. RCS WILL NOT RECOMMEND NOR BE RESPONSIBLE FOR THE INNER STRUCTURAL FRAMING REQUIREMENTS.



FLASH COLLAR WITH A 3" OVERLAP AT EACH SPLICE

BYCURB027B

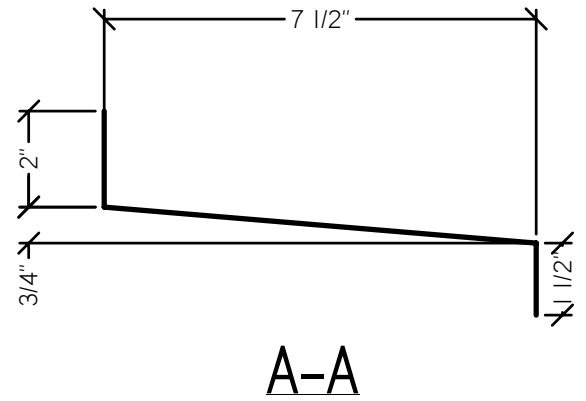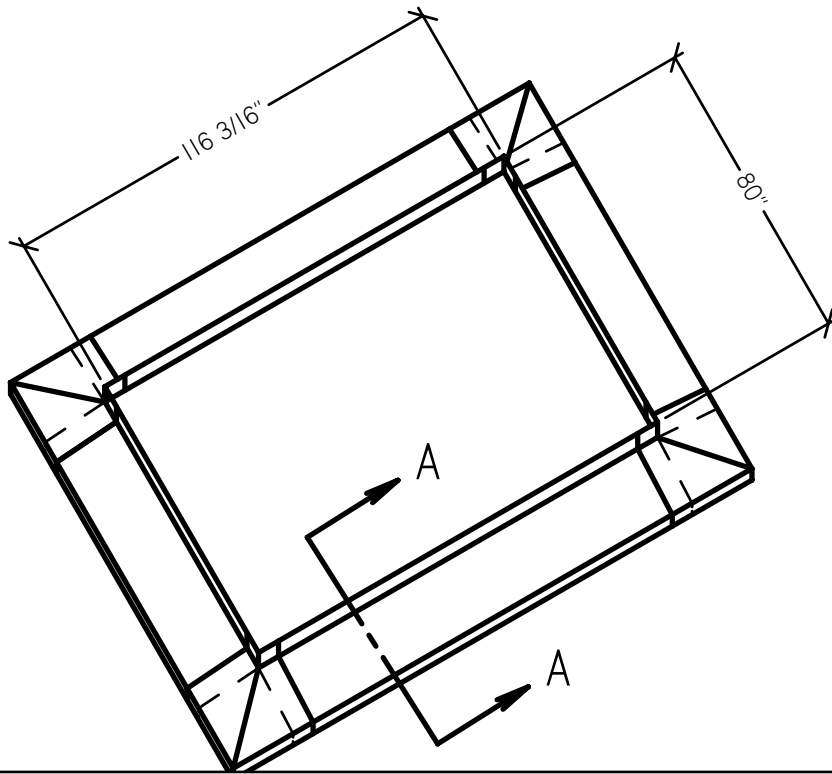

These drawings for coordination and dimensions only and do not represent a particular curb style

MBC-3 OUTER CURB

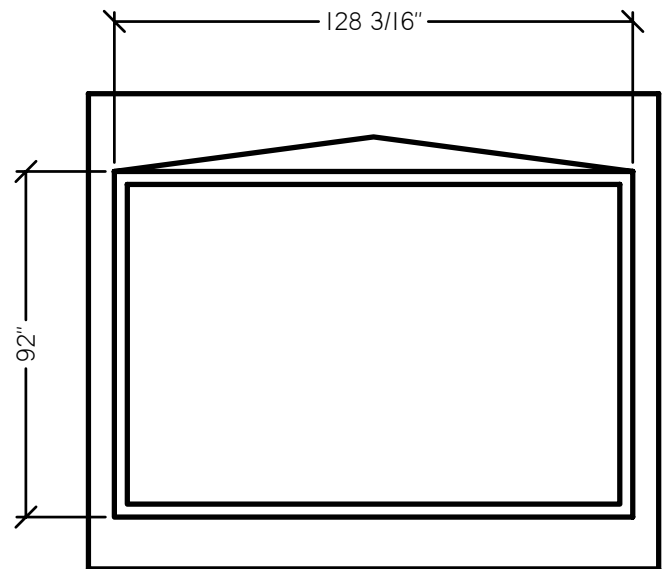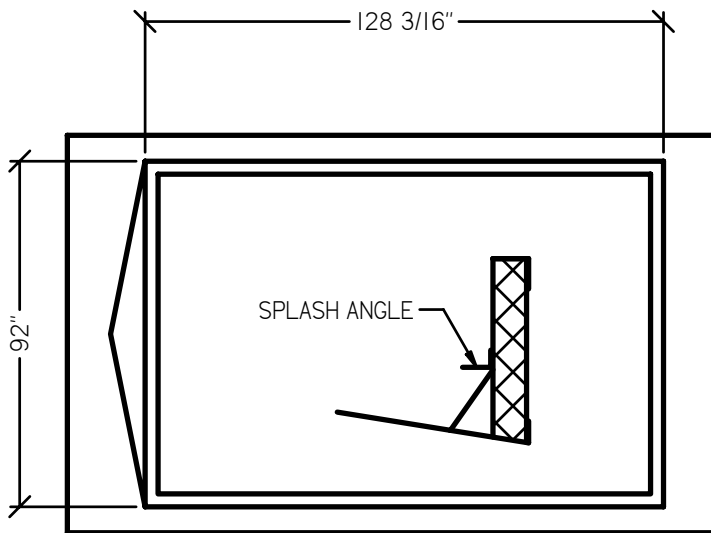

FOR OPTION A OR B

FOR OPTION C OR D

Slope: _____	Customer: _____
Min HT: _____	Job name: _____
Front Flange: _____	Qty: _____
Rear Flange: _____	Tag: _____
Side Flanges: _____	